
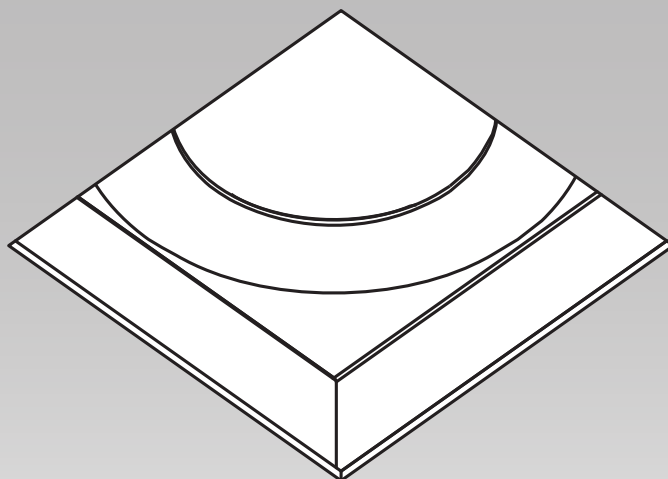



EIGER

INSTALLATION INSTRUCTIONS
FRAME & PLASTER-IN VERSIONS


DLD
ARCHITECTURAL

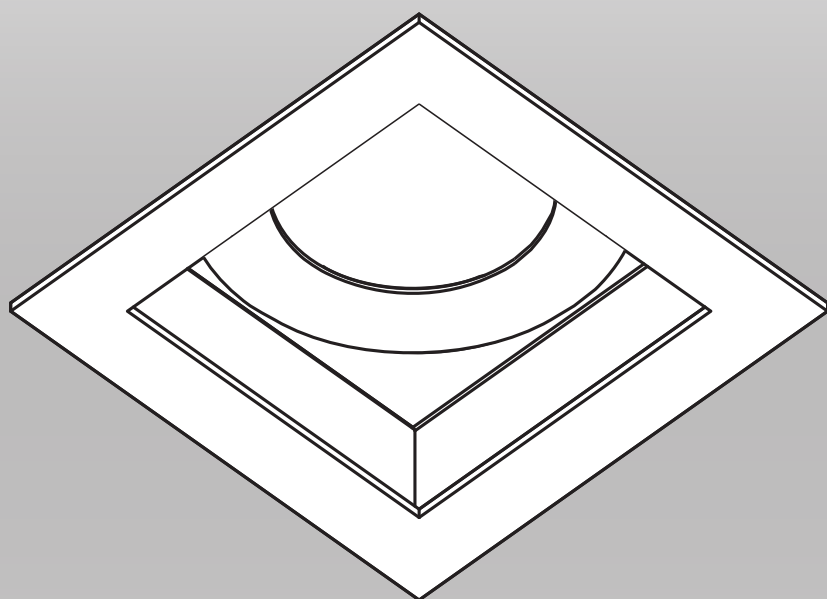

LED LIGHT ENGINES

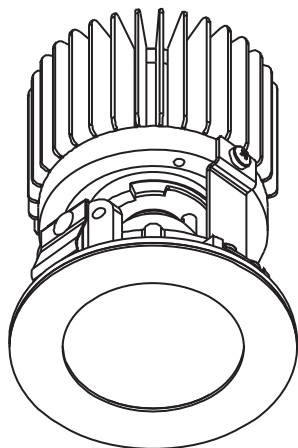


Fixed **IP44**

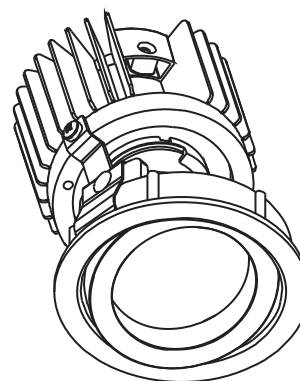


Adjustable by 30° **IP20**

CUT OUT SIZES

With frame

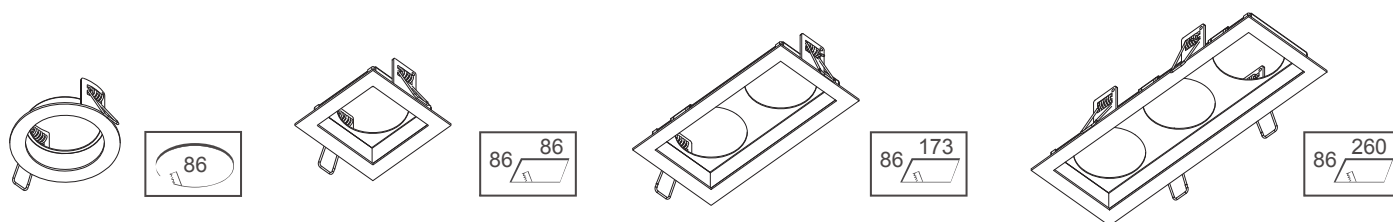

Plaster In

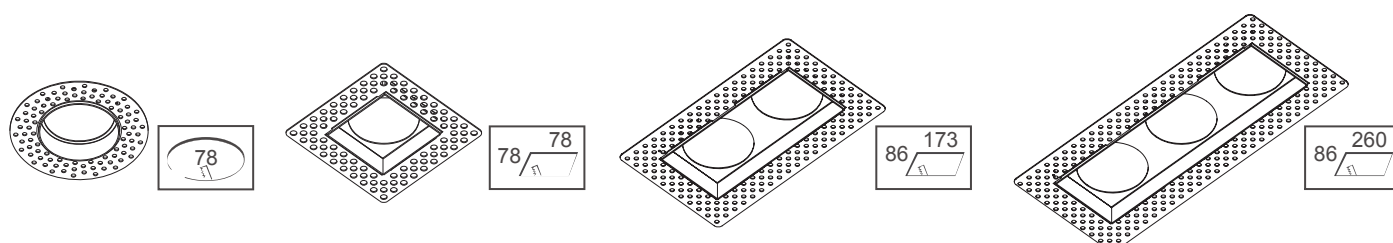

EIGER

INSTALLATION INSTRUCTIONS FRAME & PLASTER-IN VERSIONS




DLD
ARCHITECTURAL

INSTALLATION INSTRUCTIONS - EIGER WITH FRAME

It is recommended that this product is fitted by a qualified electrician.

Ensure that the power supply is turned off. Follow the steps below for installation or lamp replacement.

Once all steps have been completed, check that all screws are tightened before connecting the power supply.

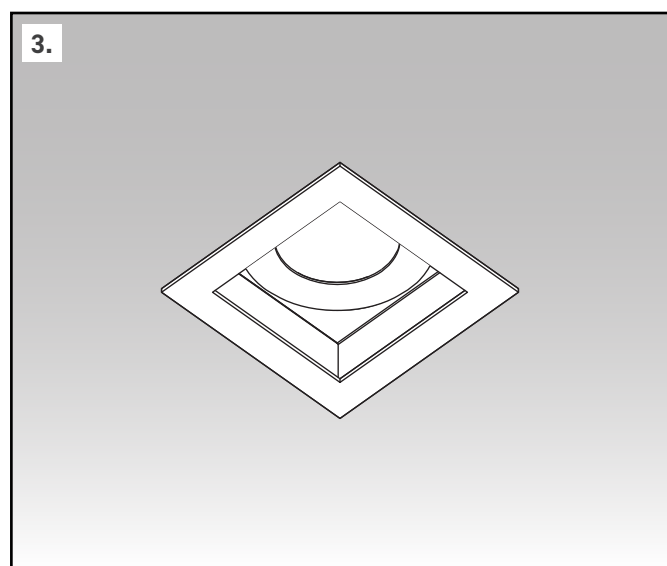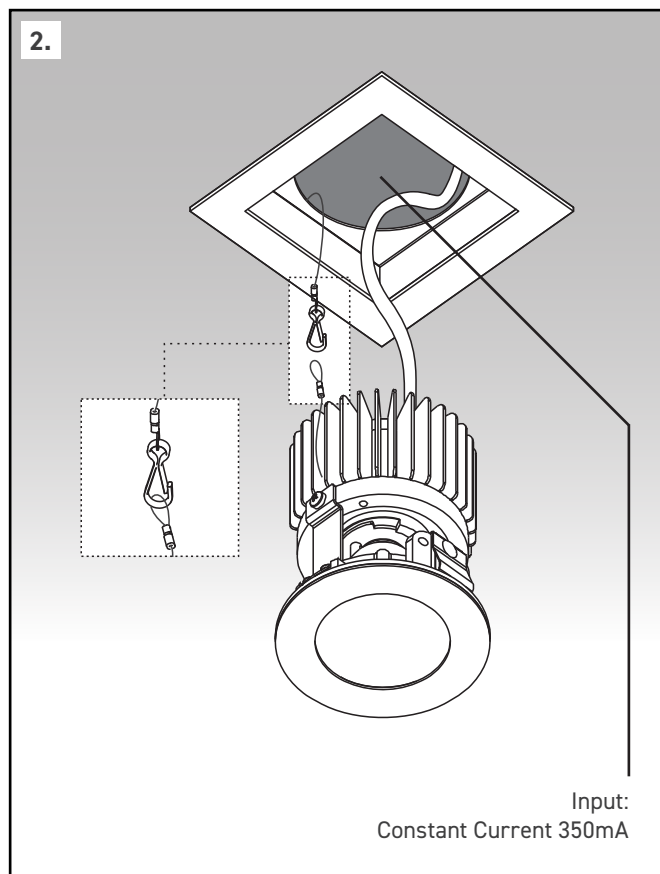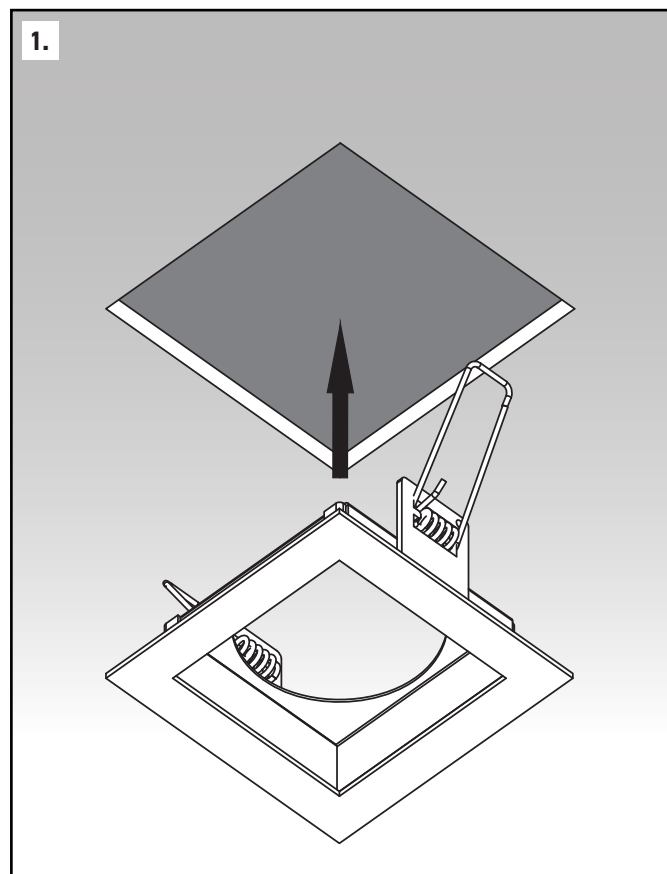

EIGER

INSTALLATION INSTRUCTIONS FRAME & PLASTER-IN VERSIONS





DLD
ARCHITECTURAL

INSTALLATION INSTRUCTIONS - EIGER PLASTER IN

It is recommended that this product is fitted by a qualified electrician.

Ensure that the power supply is turned off. Follow the steps below for installation or lamp replacement.

Once all steps have been completed, check that all screws are tightened before connecting the power supply.

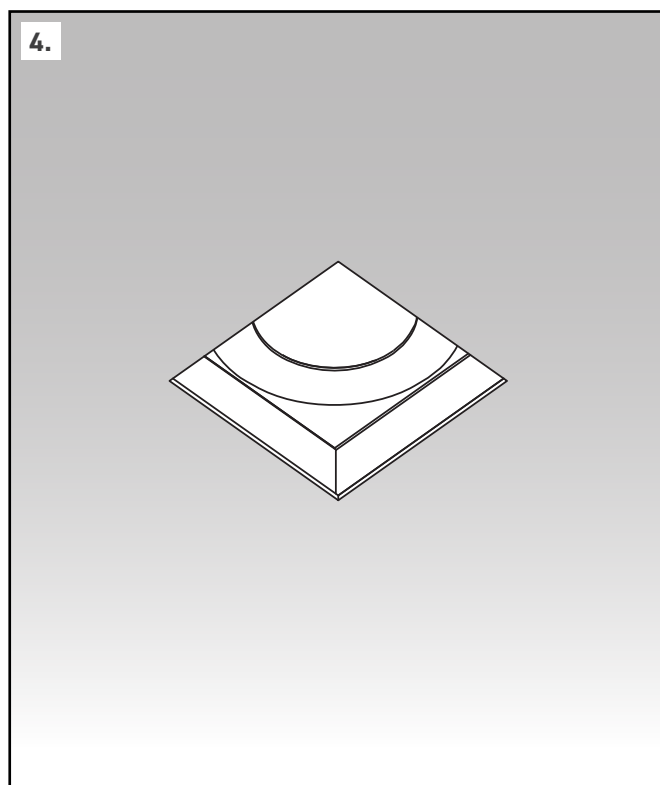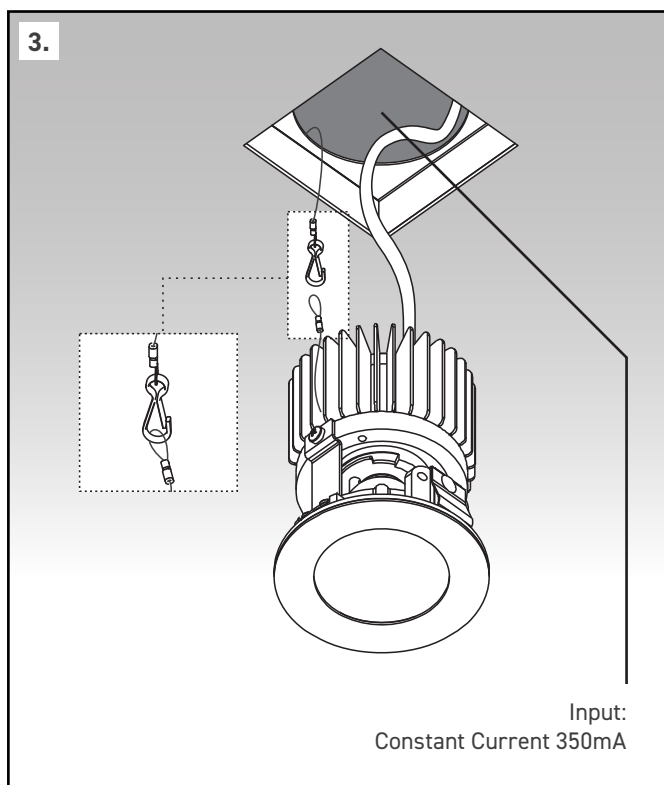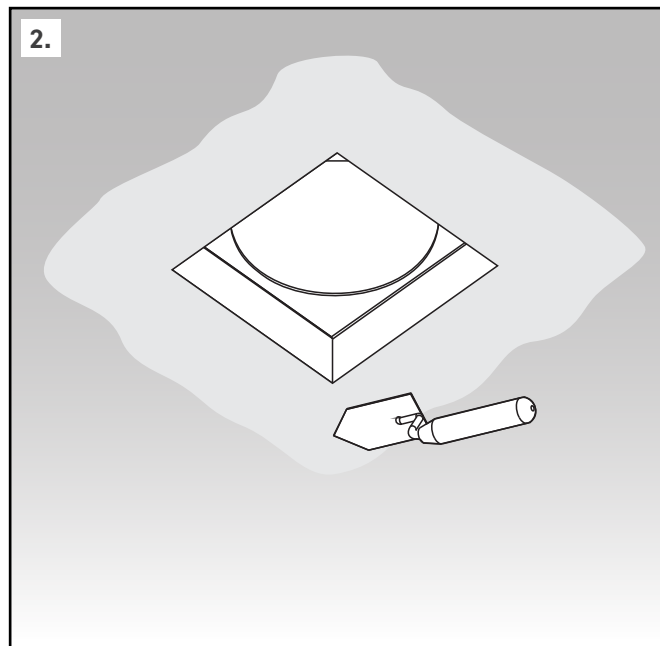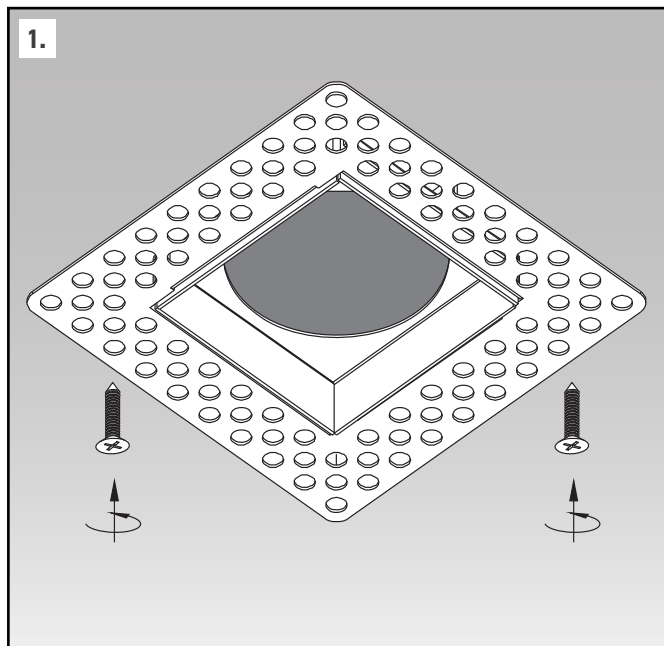


EIGER

INSTALLATION INSTRUCTIONS
FRAME & PLASTER-IN VERSIONS

DLD
ARCHITECTURAL

WIRING DIAGRAM

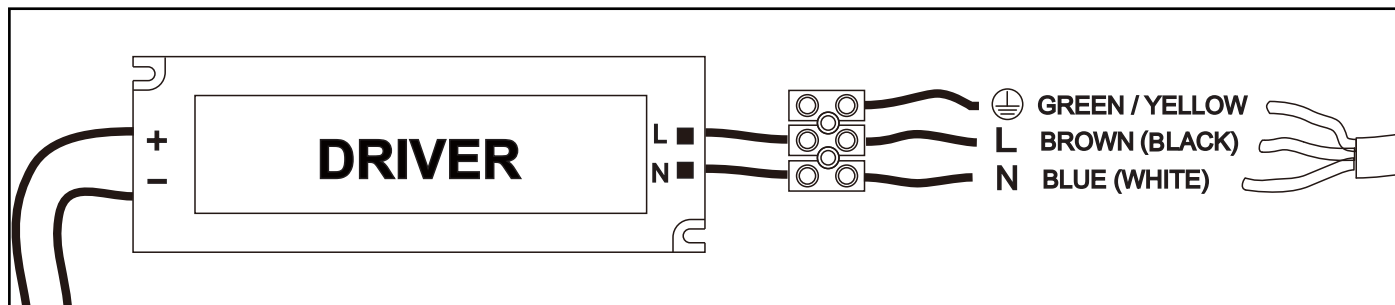

Do not clean the LED chip and reflector by hand or with a towel!

DISCLAIMER

- Only use power supplies which are certified according to the applicable IEC or 3C standards
- Check that the rating of the power supply matches that of the luminaire
- The maximum current rating must be taken into account
- The indicated typical voltage must not be used to select a constant voltage power supply. It is intended to be used to select a constant current power supply that is able to cover that typical voltage
- Take appropriate ESD measures. Avoid touching bare conductors
- LED luminaires or LED drivers should never be cleaned with chemical substances. LEDs can be damaged by contact with certain chemicals or chemical gasses
- The following substances have been proven to have a negative influence on LED performance, and must not be used in the direct environment of the LED luminaire:
 - Methyl acetate or ethyl acetate (i.e., nail polish remover)
 - Formaldehyde or butadiene (including Ashland PLIOBOND adhesive)
 - Loctite Sumo Glue
 - Gorilla Glue
 - Bleach, Bleach-containing cleaners, sprays
 - Loctite 384 adhesive
 - Loctite 7387 activator
- Remove insulation and/or provide sufficient ventilation so that the indicated maximum temperature is not surpassed
- Only connect the driver with the fitting only after the power is off. LEDs are susceptible to switching transients
- Respect polarity
- Don't test LED luminaires one by one on a power supply that is switched on

**01189 889414****sales@darklightdesign.com****darklightdesign.com**

Darklight Design
Unit 10 Brookside Business Centre
Church Road
Swallowfield
Reading
Berkshire
RG7 1TH